


NOTES:

1. MANHOLE TO CONFORM WITH DETAIL S-2005.
2. DROP BOWL HOOD SHALL NOT BE INSTALLED UNLESS SPECIFICALLY CALLED OUT BY THE DESIGN ENGINEER. BASED ON DESIGN GRADES OR USE OF FORCE MAINS.

INLET PIPE DIA.	RELINDER DROP BOWL	DROP PIPE DIA.	MANHOLE MIN. DIA.
8"	A-6	6"	48"
10"	B-8	8"	48"
12"	B-10	10"	60"

CUSTOM DROP BOWLS SHALL BE DESIGNED FOR PIPE INLET DIA. LARGER THAN 12"

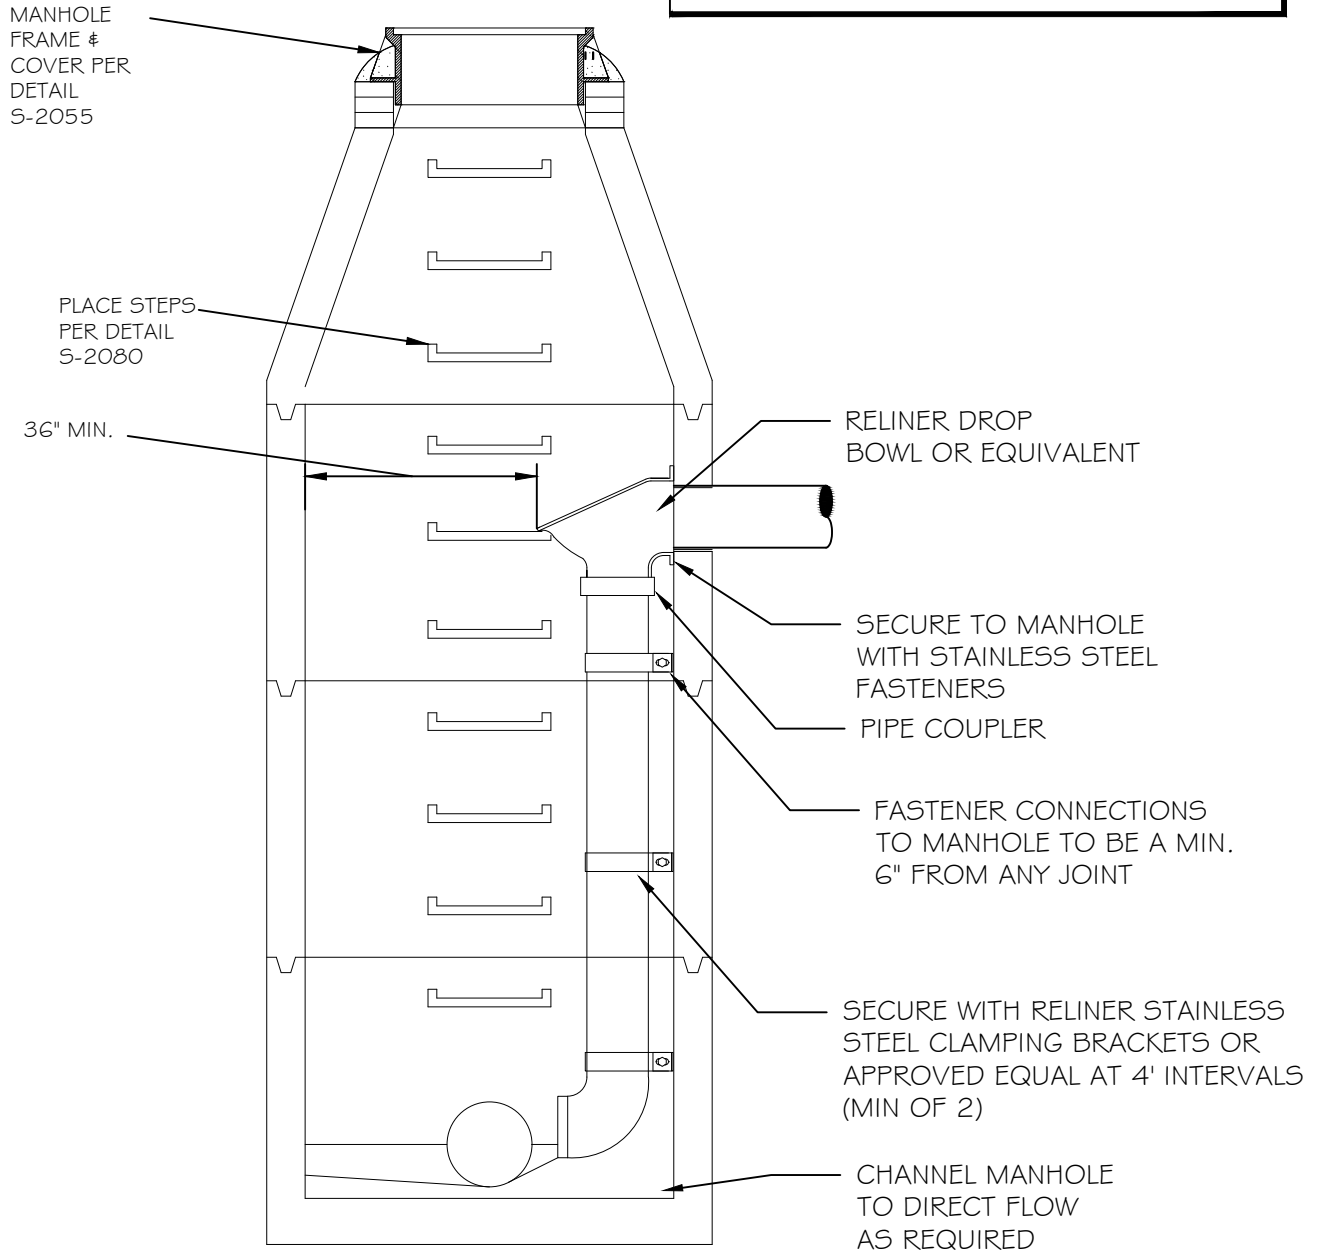

Detail Drawing may not be altered or changed in any manner except by the Public Works Director. It is the responsibility of the user to acquire the most current version.

CITY OF MOLALLA
DEPARTMENT OF PUBLIC WORKS



INSIDE DROP MANHOLE DETAIL
SANITARY AND STORM

DRAWN BY	GF	02/2019
CHECKED BY	GF	02/2019

S-2010